


**NOTES:**

1. FOR TERMINAL BOX WIRING SEE STANDARD PLAN CP-6.
2. TEST STATION MAY BE DELETED AT THE DISCRETION OF THE CITY ENGINEER. IF THE TEST STATION IS DELETED, CONNECT THE ANODE LEAD DIRECTLY TO THE FITTING PER STANDARD PLAN CP-16.
3. TEST STATIONS SHALL BE SET BEHIND CURB OR SIDEWALK.

(Not To Scale)

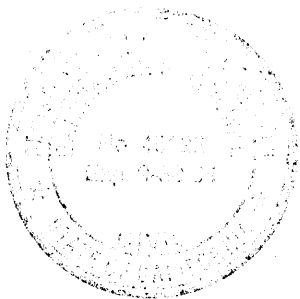

**ENGINEERING  
DEPARTMENT**

**ANODE TEST STATION - RISER**

*Balwinder S. Grewal*  
BALWINDER S. GREWAL CITY ENGINEER

DATE: OCT. 31, 2000  
REVISED: JUNE 20, 2003

SHEET NO.  
**CP-9**