


**TYPE 'A' WALL
6' MAX.**

WALL		REBAR	
H	W	①	②
3'-4"	3'-2"	#4	#4
4'-0"	3'-6"	#4	#4
4'-8"	3'-10"	#4	#5
5'-4"	4'-2"	#4	#4
6'-0"	4'-6"	#5	#4

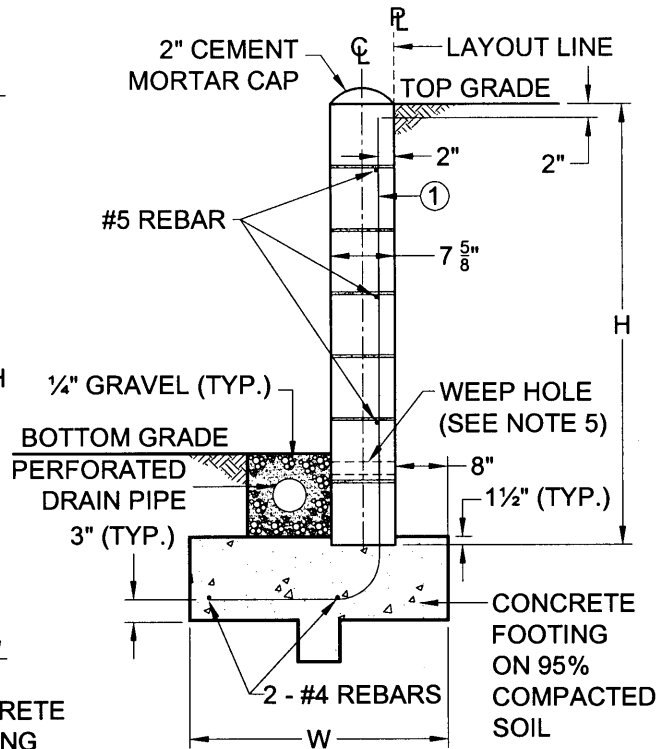

**TYPE 'A' WALL
4'-8" MAX.**

NOTES:

1. DRAIN SHALL BE CONNECTED TO THE NEAREST CATCH BASIN.
2. A CLEANOUT SHALL BE PROVIDED EVERY 100'.
3. IN THE ABSENCE OF PERFORATED DRAIN PIPE, A 2" Ø SCH 40 PVC WEEPHOLES AT 25' O.C. CAN BE PROVIDED UPON CITY ENGINEER'S DISCRETION AND APPROVAL.
4. PLACE EXPANSION JOINTS AT 40' C.C. MAX. OMIT MORTAR FROM VERTICAL JOINT IN THE FIRST COURSE ABOVE PROPOSED GROUND LINE AT 32" CENTERS FOR WEEP HOLES. FILL CELLS WITH CONCRETE.
5. PROVIDE 3 4" Ø SCH 40 PVC WEEP HOLES IN THE WALL PER LOT (ON THE PROPERTY LINES AND ITS MIDPOINT).

(Not To Scale)



**ENGINEERING
DEPARTMENT**

MASONRY RETAINING WALL (TYPE A)

John E. Stevenson
JOHN E. STEVENSON CITY ENGINEER

DATE: MAR. 26, 2001

REVISED:

SHEET NO.

G-3a