


HORIZON RAINSAFE MODEL #SB 2255
ENCLOSURE ASSEMBLY (SEE NOTE 2)

NOTES:

1. SURGE PROTECTORS SHALL BE INSTALLED.
2. NO SUBSTITUTION IS ALLOWED ON THE ENTIRE ASSEMBLY UNLESS AN EQUALLY COMPARABLE ENCLOSURE ASSEMBLY HAS BEEN SUBMITTED TO AND APPROVED BY THE PARKS AND RECREATION DEPARTMENT.

V.I.T. STRONG BOX DSS
STAINLESS STEEL
CONTROLLER PEDESTAL
(SEE NOTE 2)

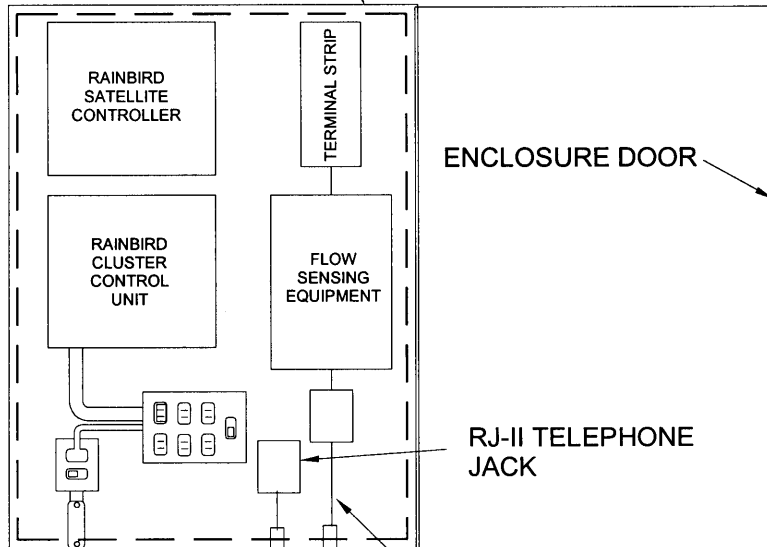

TO TERMINAL STRIP FOR
DATA INDUSTRIAL FLOW
METER

CONCRETE
SLAB

CONNECT TO PHONE
AND FLOW SENSORS

LEGEND:

- ① 120 VAC ELECTRICAL SERVICE
- ② 3/4" Ø x 10' GROUND ROD
- ③ TO TELEPHONE SERVICE
- ④ PE-89 WIRE TO DATA INDUSTRIAL MODEL IR220 FLOW SENSOR (SEE NOTE 2)
- ⑤ REMOTE CONTROL WIRED CONDUIT



**ENGINEERING
DEPARTMENT**

**MAXICOM SATELLITE
AND ENCLOSURE ASSEMBLY**

BALWINDER S. GREWAL CITY ENGINEER

DATE: MAR. 9, 2001
REVISED: JUNE 16, 2003

SHEET NO.
I-6