* OR APPROVED EQUAL

** THE USE OF RECYCLED A.B. SHALL NOT BE ALLOWED

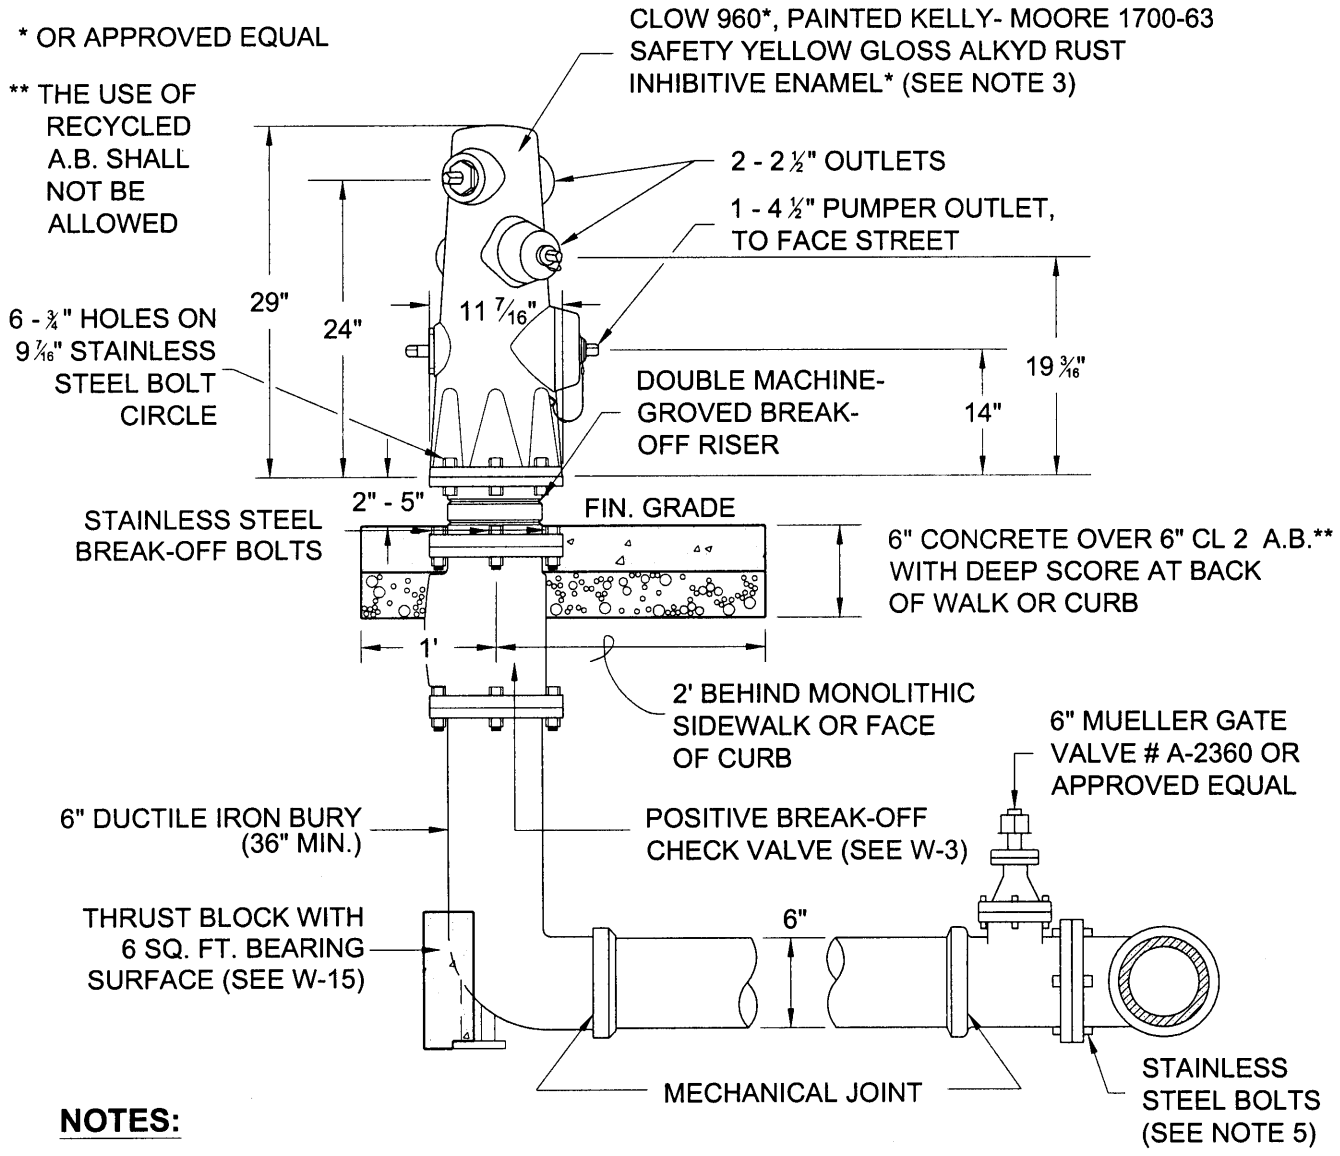

NOTES:

1. FOR RUNS GREATER THAN 35 FEET, A SECOND VALVE SHALL BE PLACED BETWEEN 8 AND 18 FEET FROM THE HYDRANT.
2. PLACE BLUE, TWO-WAY REFLECTIVE PAVEMENT MARKER OPPOSITE HYDRANT 3 FEET IN FROM CENTERLINE OF STREET.
3. HYDRANTS SHALL COMPLY WITH THE LATEST REVISION OF AWWA C503.
4. RED CURB OPPOSITE THE FIRE HYDRANT IS NOT REQUIRED UNLESS DIRECTED BT THE CITY ENGINEER.
5. ALL BOLTS CONNECTING TO THE WATERLINE SHALL BE STAINLESS STEEL.

(Not To Scale)

REGISTERED PROFESSIONAL ENGINEER
BALWINDER S. GREWAL
No. 49122
Exp. 9-30-06
CIVIL
STATE OF CALIFORNIA

CITY OF BRENTWOOD

ENGINEERING DEPARTMENT

INDUSTRIAL/COMMERCIAL FIRE HYDRANT INSTALLATION

BALWINDER S. GREWAL CITY ENGINEER

DATE: JUN. 20, 2003
REVISED: APR. 29, 2005

SHEET NO. W-2

H:\ebaula\Projects\StdPlans\New Stds\W-2r1.dwg, 5/6/2005 2:50:13 PM