



**WATER SERVICE NOTES:**

1. WATER METERS SHALL BE SENSUS WITH SENSUS MXU 505 UNIT.
2. METERS SHALL BE INSTALLED CENTERED IN THE METER BOX.
3. METER TO BE SET AT TIME OF PLUMBLING EXTENSION TO BUILDING.
4. METER BOX SHALL BE FREE FROM DEBRIS, DIRT AND LITTER.
5. IRRIGATION SERVICE AND/OR WELL ONSITE REQUIRES BACKFLOW PREVENTION DEVICE BEHIND METER.
6. INSTALL CATHODIC PROTECTION PER CP-12.
7. ALL NON-POTABLE APPLICATIONS SHALL BE COLOR-CODED PURPLE.
8. ALL BOLTS SHALL BE STAINLESS STEEL.
9. FOR WATER SERVICE STANDARDS, REFER TO W-5 AND W-7; FOR STANDARD METER INSTALLATION, REFER TO W-6.

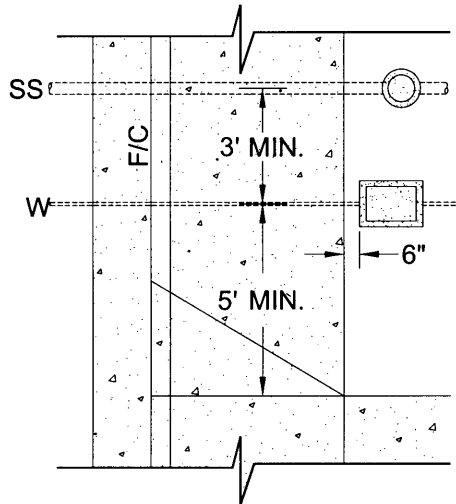

**TYPICAL LAYOUT**

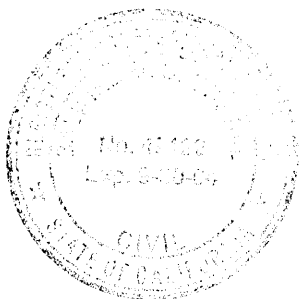

**ENGINEERING  
DEPARTMENT**

**WATER SERVICE NOTES**

*B. S. Grewal*  
BALWINDER S. GREWAL CITY ENGINEER

DATE: JUNE 20, 2003

REVISED:

SHEET NO.

**W-6a**